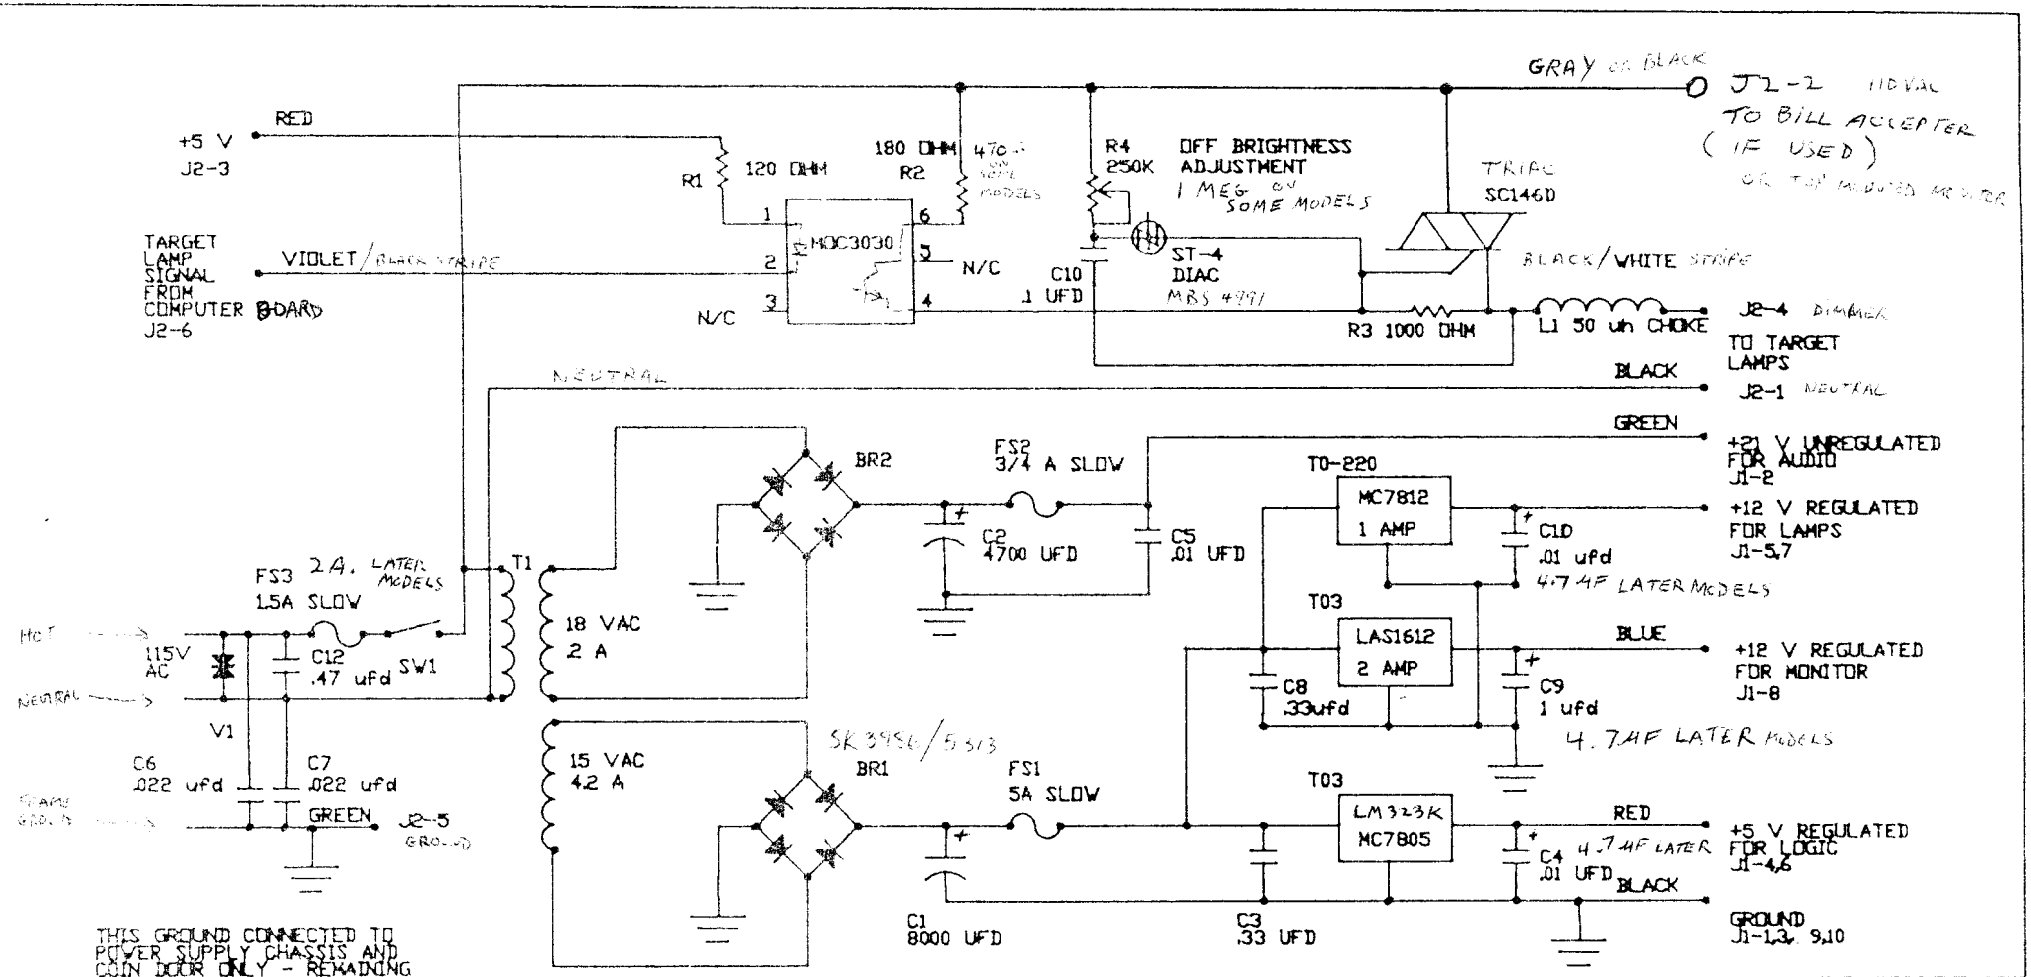

LAS 1612 = SK 9337/1912

LM 323K = SK 9067/931

MC 7812 = SK 3592/966

SC 146D = SK 3533/5635

MOC 3030 = SK 2049/3049

BR-82D = SK 3647/167

ARACHNID INC.

SCALE NONE	APPROVED BY	DRAWN BY E.G.H.
DATE 7-31-86		REVISED 11-19-86

TITLE: 6000 SERIES POWER SUPPLY

DRAWING NUMBER: 38-0019

CAPACITOR C-9 IS PRONE TO FAIL, CAUSES LOW POWER TO MONITOR. REPLACE WITH 4.7 MFD @ 35 V TANTALUM